


# 18. WPMZ-6 Control flow rate of the cooling circulation device

Outputs the difference calculation result to the PLC / controller

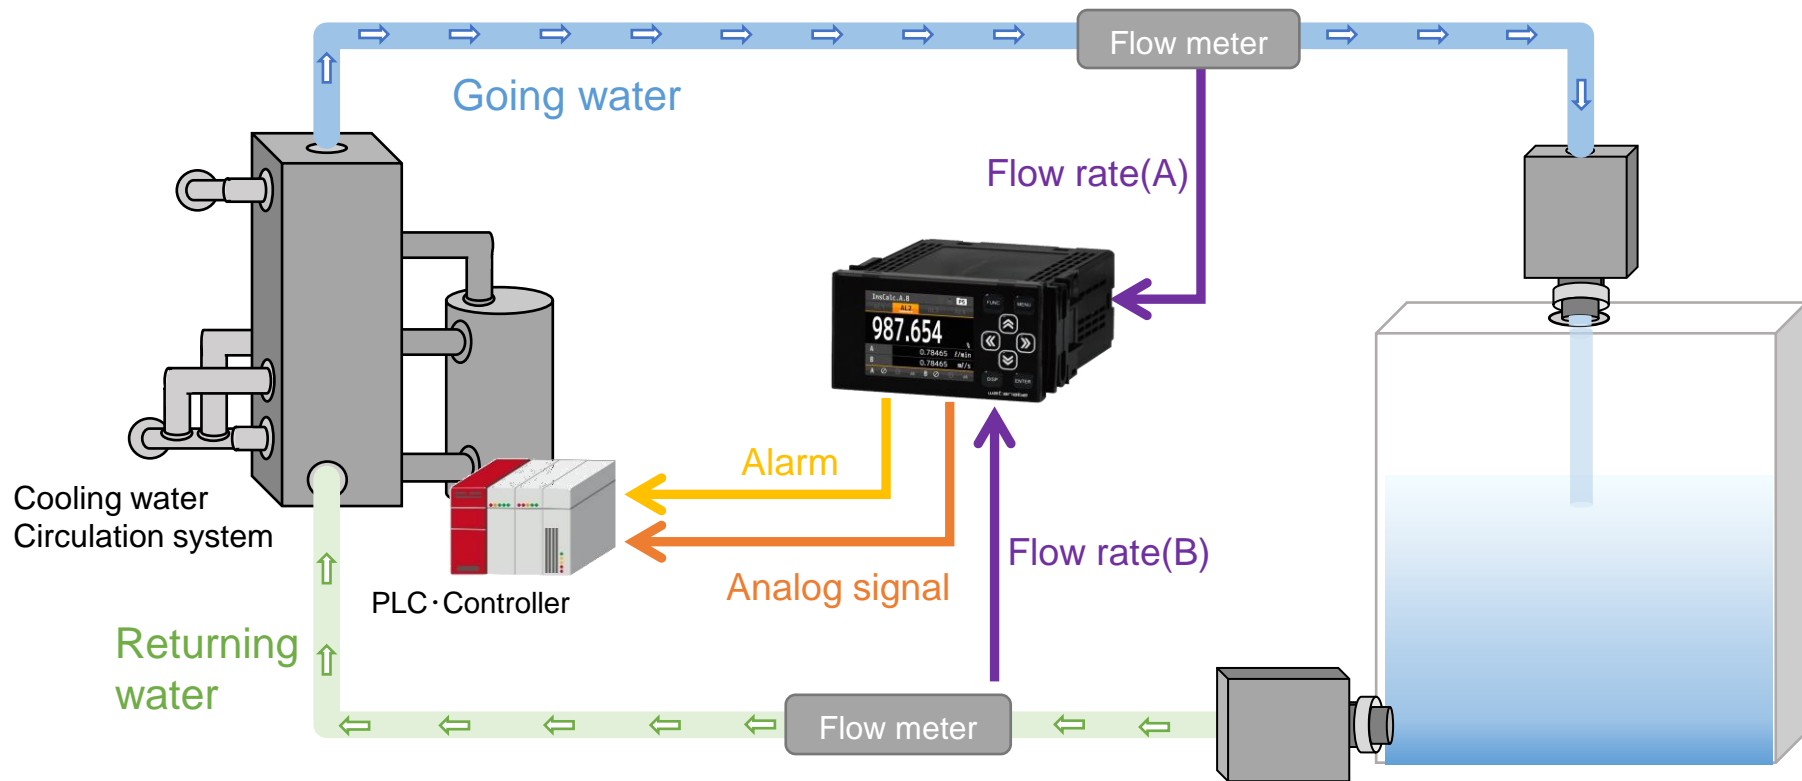

Adjustment operation such as changing the alarm level can be easily performed on site.